




Lakeland

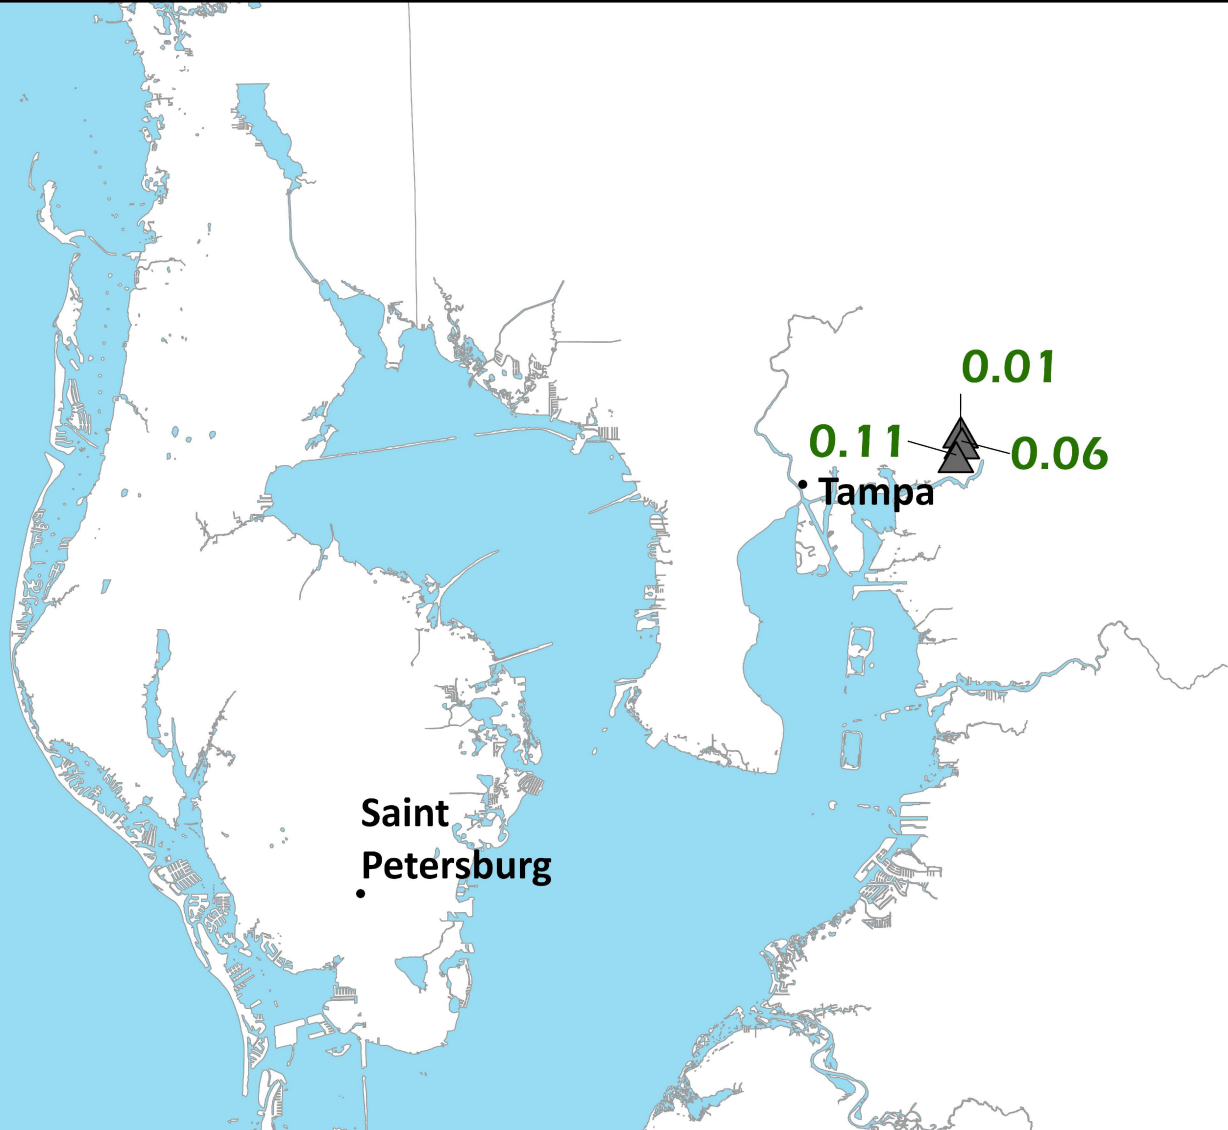

2018 - 2020 Monitored Design Values Lead - Pb

National Ambient Air Quality Standard:
0.15 µg/m³ 3-Month Rolling Average Concentration[^]
 - All Florida Monitors in Compliance -

[^]Design value is based on the maximum rolling 3-month average for the 38 month period beginning the last two months of the preceding year.

