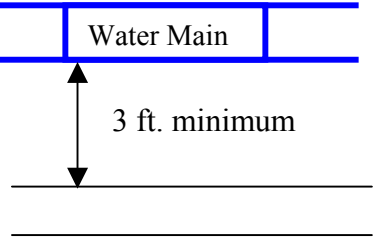
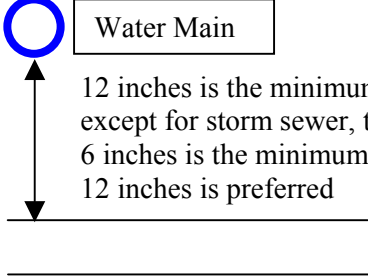
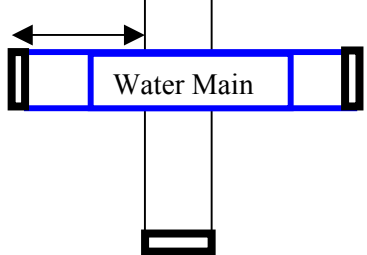
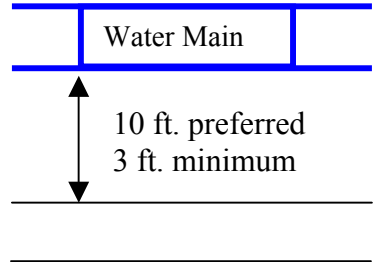
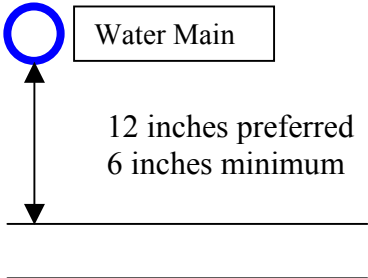
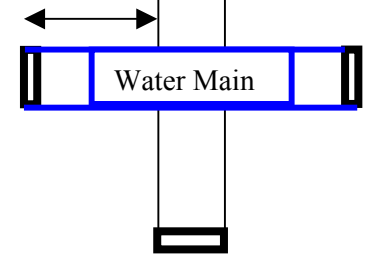
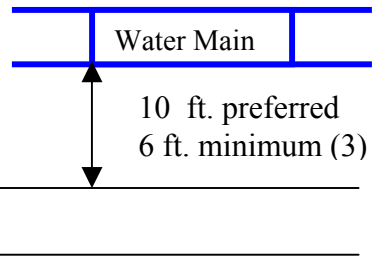
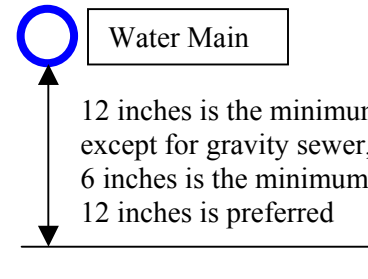
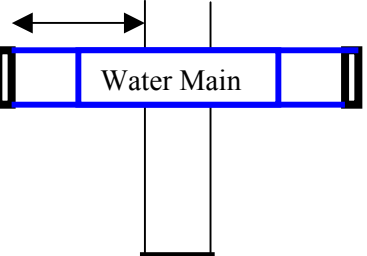


LOCATION OF PUBLIC WATER SYSEM MAINS IN ACCORDANCE WITH F.A.C. RULE 62-555.314

Other Pipe	Horizontal Separation	Crossings (1)	Joint Spacing @ Crossings (Full Joint Centered)
Storm Sewer, Stormwater Force Main, Reclaimed Water (2)	 <p style="text-align: center;">Water Main</p> <p style="text-align: center;">3 ft. minimum</p>	 <p style="text-align: center;">Water Main</p> <p style="text-align: center;">12 inches is the minimum, except for storm sewer, then 6 inches is the minimum and 12 inches is preferred</p>	<p style="text-align: center;">Alternate 3 ft. minimum</p>  <p style="text-align: center;">Water Main</p>
Vacuum Sanitary Sewer	 <p style="text-align: center;">Water Main</p> <p style="text-align: center;">10 ft. preferred 3 ft. minimum</p>	 <p style="text-align: center;">Water Main</p> <p style="text-align: center;">12 inches preferred 6 inches minimum</p>	<p style="text-align: center;">Alternate 3 ft. minimum</p>  <p style="text-align: center;">Water Main</p>
Gravity or Pressure Sanitary Sewer, Sanitary Sewer Force Main, Reclaimed Water (4)	 <p style="text-align: center;">Water Main</p> <p style="text-align: center;">10 ft. preferred 6 ft. minimum (3)</p>	 <p style="text-align: center;">Water Main</p> <p style="text-align: center;">12 inches is the minimum, except for gravity sewer, then 6 inches is the minimum and 12 inches is preferred</p>	<p style="text-align: center;">Alternate 6 ft. minimum</p>  <p style="text-align: center;">Water Main</p>
On-Site Sewage Treatment & Disposal System	<p style="text-align: center;">10 ft. minimum</p>	<p style="text-align: center;">---</p>	<p style="text-align: center;">---</p>

- (1) Water main should cross above other pipe. When water main must be below other pipe, the minimum separation is 12 inches.
- (2) Reclaimed water regulated under Part III of Chapter 62-610, F.A.C.
- (3) 3 ft. for gravity sanitary sewer where the bottom of the water main is laid at least 6 inches above the top of the gravity sanitary sewer.
- (4) Reclaimed water not regulated under Part III of Chapter 62-610, F.A.C.